

ALARM VALVE

4" MODEL "D"

Flange/Groove



Listed by: Underwriters Laboratories Inc.
Underwriters Laboratories of Canada
Approved by: Factory Mutual

PROTECTION INCENDIE LTÉE

VENUS
FIRE PROTECTION LTD

4105 Portland Blvd,
Sherbrooke, (Quebec) J1L 1X9
Tél:(819) 820-8000 Fax:(819) 820-8002
email : info@venus.ca

“ASTRA” 4” ALARM VALVE MODEL “D” Flange/Groove




DESCRIPTION AND OPERATION

The “Astra” 4” Alarm Valve model “D” must be installed vertically in the main supply to a wet type sprinkler system. Where water pressure fluctuates, such as encountered with city water supplies, variable pressure trim including an Excess Pressure Pump must be used. For installations where water pressure does not fluctuate, such as tank supplies, constant pressure trim is used without the need of an Excess Pressure Pump.

Care must be exercised when installing check valves in the trim to be certain that they are located with the arrow on the body pointing in the proper direction. The arrow on the body of the 1/2” check valve **must** point toward the alarm valve body.

Parts list

ITEM	Part No.	DWG No	DESCRIPTION
1	AV-10-1	AVD 4005	Body
2	AV-10-7	AV 4011	Water seat
3	AV-10-2	AV 4021	Cover
4	AV-10-17	AV 4019	Cover gasket
5	AV-10-3	AV 4008	Cover bolt
6	AV-10-19	AV 4010	Clapper
7	AV-10-9	AV 4013	Clapper pin
8	AV-10-8	AV 4012	Bushing
9	AV-10-10	AV 4014	Plug
10	AV-10-16	AV 4018	Clapper gasket
11	AV-10-14	AV 4016	Seal retainer
12	AV-10-11	AV 4015	Bolt
13	AV-10-15	AV 4017	O’ Ring
14	AV-10-13	AV 4015	Lockwasher
15	AV-10-12	AV 4015	Nut

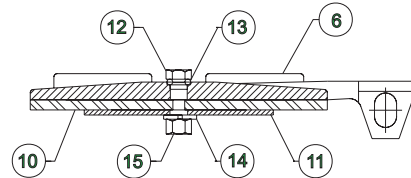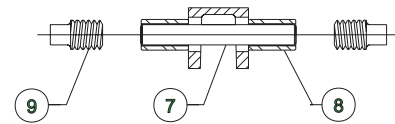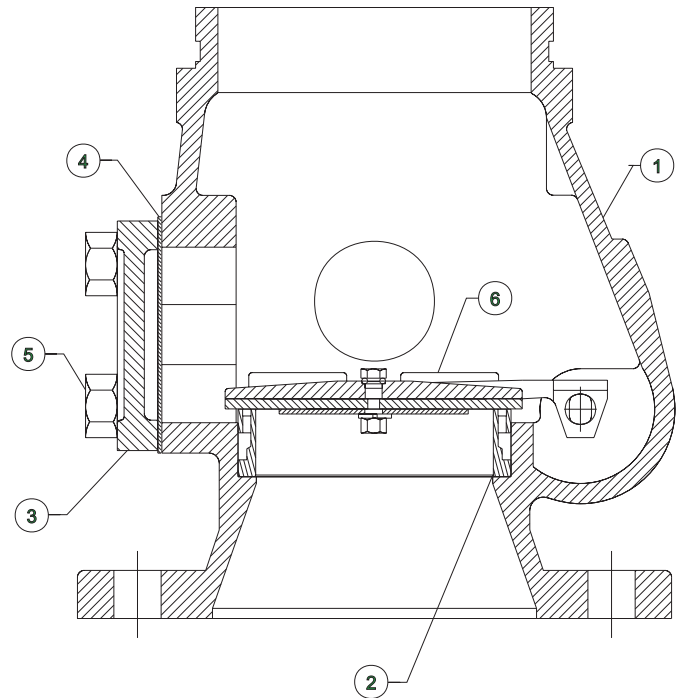

4" Alarm Valve Model “D”	
Face to face	10 3/8"
Weight	50 lbs.


PROTECTION INCENDIE LTÉE

VENUS

FIRE PROTECTION LTD

MADE IN CANADA

4" ALARM TRIM (ASTRA) (TO USE WITH RETARD CHAMBER)

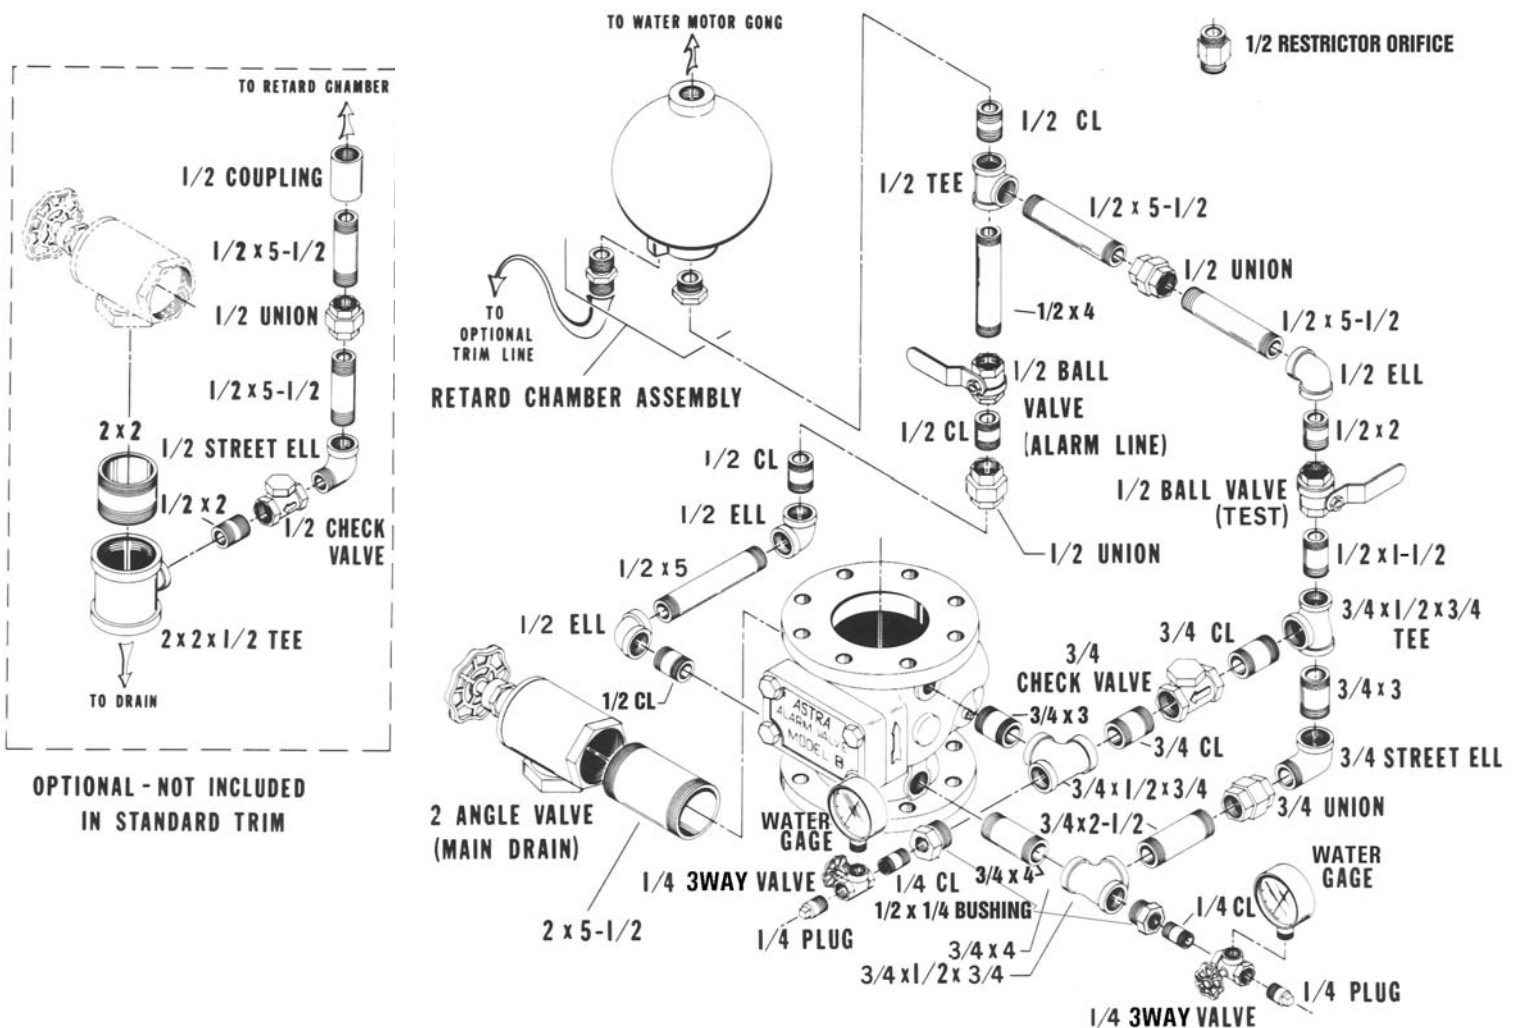

PROTECTION INCENDIE LTÉE

VENUS

FIRE PROTECTION LTD

4105 Portland Blvd,
Sherbrooke, (Quebec) J1L 1X9
Tél:(819) 820-8000 Fax:(819) 820-8002
email : info@venus.ca